

ADDENDUM: SPlicing OF FACTORY ATTACHED GALVANIZED FLANGES


The splicing of the interior insulation materials, screen and interleaved metallic foils are to be performed in the same manner as the rolled versions of the fire barrier.

Pre-attached flanges used on fire barrier for 8" wide expansion joints and larger require an additional splicing operation. You have two choices in dealing with the pre-attached flanges:

Note: Portions of the galvanized flange have been deleted for illustration clarity.

OPTION #1:

Trim back one flange and butt the two flanges together.

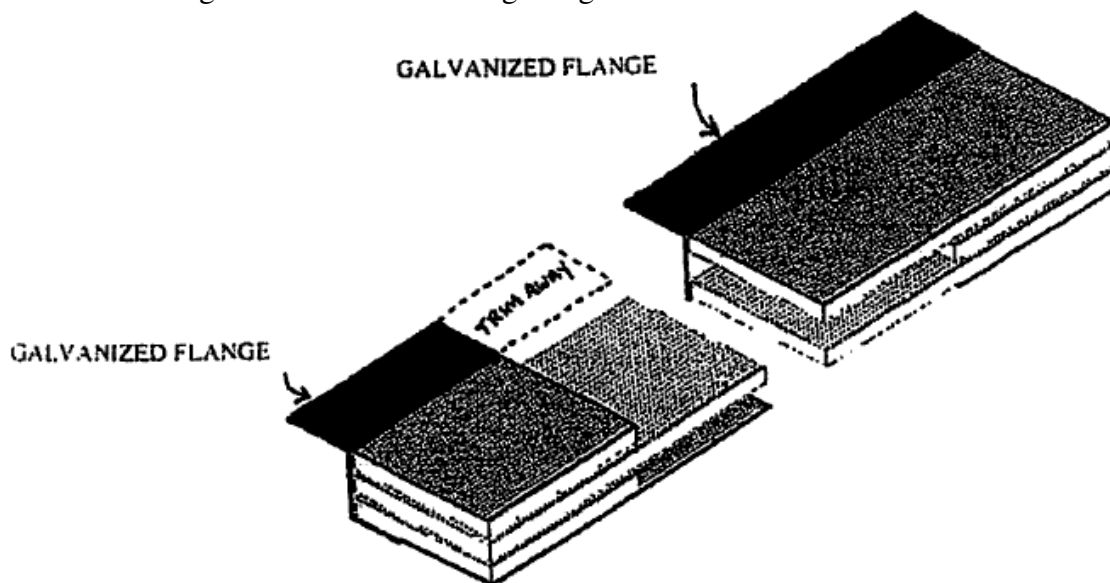

OPTION #2:

Do not trim back any flange and overlap two layers of the flange through the entire splice zone.

